


# LightSync™ Data Line Switch Order Form

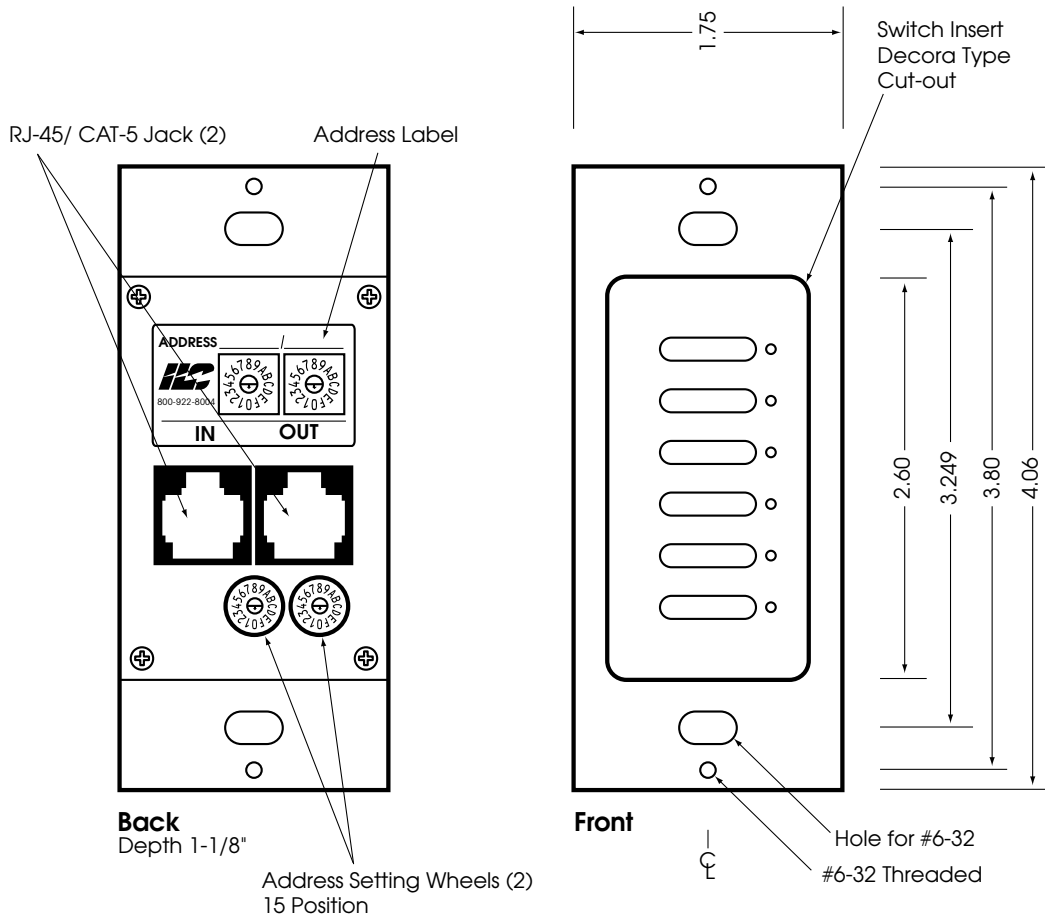

LightSync – Network Switch Device

LightSync Switch Options	Location _____ # gangs _____
<p><b>CAT-5 ready or Direct Wire:</b>  <input type="checkbox"/> CAT-5 (C)   <input type="checkbox"/> Direct Wire (D)</p> <p><b>Insert Color:</b>                      <b>Plate Color:</b>  <input type="checkbox"/> White (WH)   <input type="checkbox"/> Ivory (IV)   <input type="checkbox"/> White (WH)   <input type="checkbox"/> Ivory (IV)  <input type="checkbox"/> Black (BL)   <input type="checkbox"/> Gray (GY)   <input type="checkbox"/> Black (BL)   <input type="checkbox"/> Gray (GY)</p> <p><b>Number of switches per device:</b>  <input type="checkbox"/> 1   <input type="checkbox"/> 2   <input type="checkbox"/> 3   <input type="checkbox"/> 4   <input type="checkbox"/> 5   <input type="checkbox"/> 6</p> <p><b>Cover plate:</b>  <input type="checkbox"/> Lexan (P)   <input type="checkbox"/> Painted steel w/screw (S)</p> <p><b>Number of gangs in plate per station:*</b>                      (each device =1 gang standard)  <input type="checkbox"/> 1   <input type="checkbox"/> 2   <input type="checkbox"/> 3   <input type="checkbox"/> 4</p>	<p><b>Optional Engraving:</b>                      (10 characters maximum)</p> <p>SW#1 _____</p> <p>SW#2 _____</p> <p>SW#3 _____</p> <p>SW#4 _____</p> <p>SW#5 _____</p> <p>SW#6 _____</p> <p><b>Total number of devices                      this configuration</b> _____</p>

\*Note: A plate is included with correct # of gangs for each station ordered, leave blank if unit being specified is part of a multiple switch unit