


# High Voltage Divider Installation

Typical LightMaster 16 Enclosure Layout  
shown with EM/120/277 VAC Voltage Dividers



- Divider can be factory or field mounted between each pair of relays, for dividing 120 from 277 VAC sections, or normal from emergency sections.
- Emergency section should be located at the top of panel to allow the power supply transformers to be connected to a dedicated emergency circuit 120/277 VAC.
- Once desired mounting position is determined, mark and drill holes for the 4- #8 self-drilling screws. Fit the voltage divider in the enclosure and fasten screws.

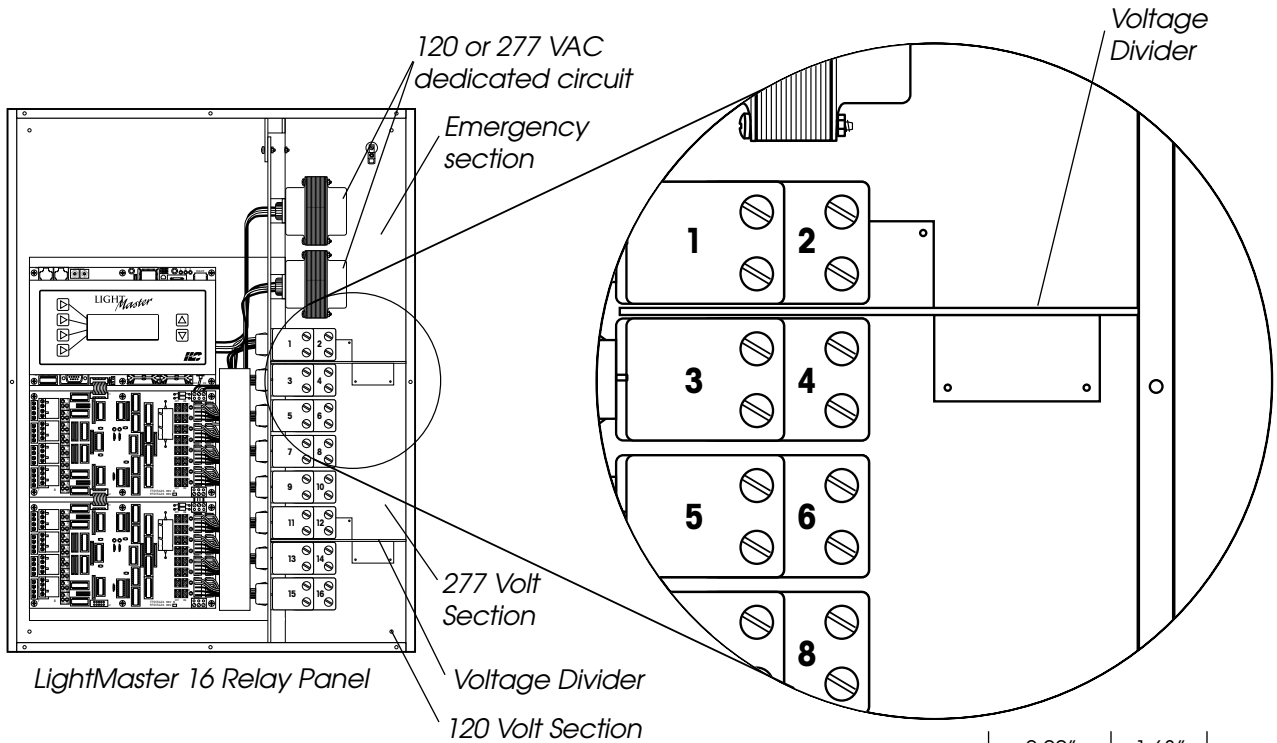