


# MODBUS Serial Interface

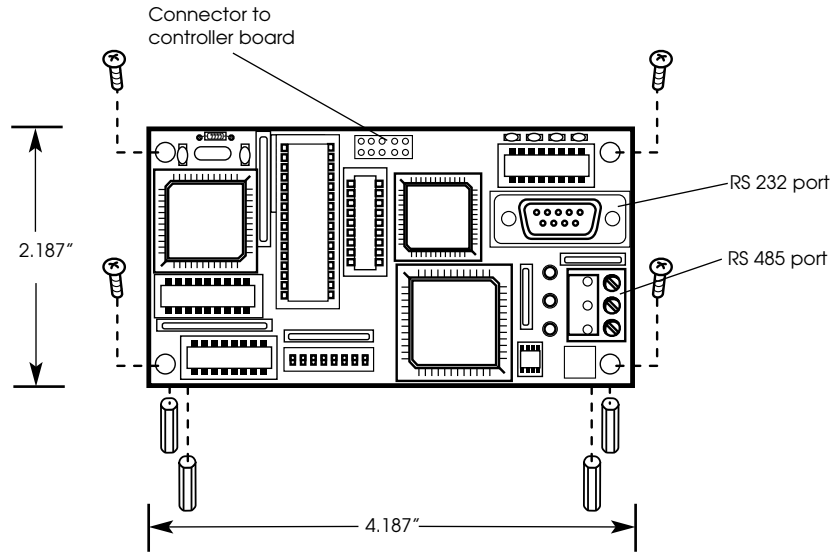

## General

- Use ASCII or RTU control protocol
- Connect directly to the MODBUS RS 485 bus
- Allows status reporting and direct control of relays

## Programming

- Once plugged into the lighting control panel, MODBUS setup options can be programmed and reviewed directly from the LightMaster keypad

## Supported Commands

- 01 Read coil status
- 02 Read input status
- 05 Force single coil
- 15 Force multiple coils

For more information refer to Modicon Modbus Protocol Reference Guide (PI-MBUS-300)

## Physical

- Plug-in module designed for mounting to LightMaster main board

## Operating Environment

- Location Interior space
- Operating Temperature 0° to 50° C (32° to 112° F)
- Relative Humidity 10% to 90% Non-Condensing

## Certifications

- UL
- FCC Approval for commercial and residential use

## Configuration

- Soft configuration