


LightSync Conditional Occupancy Sensor 8 Input Module Installation Details

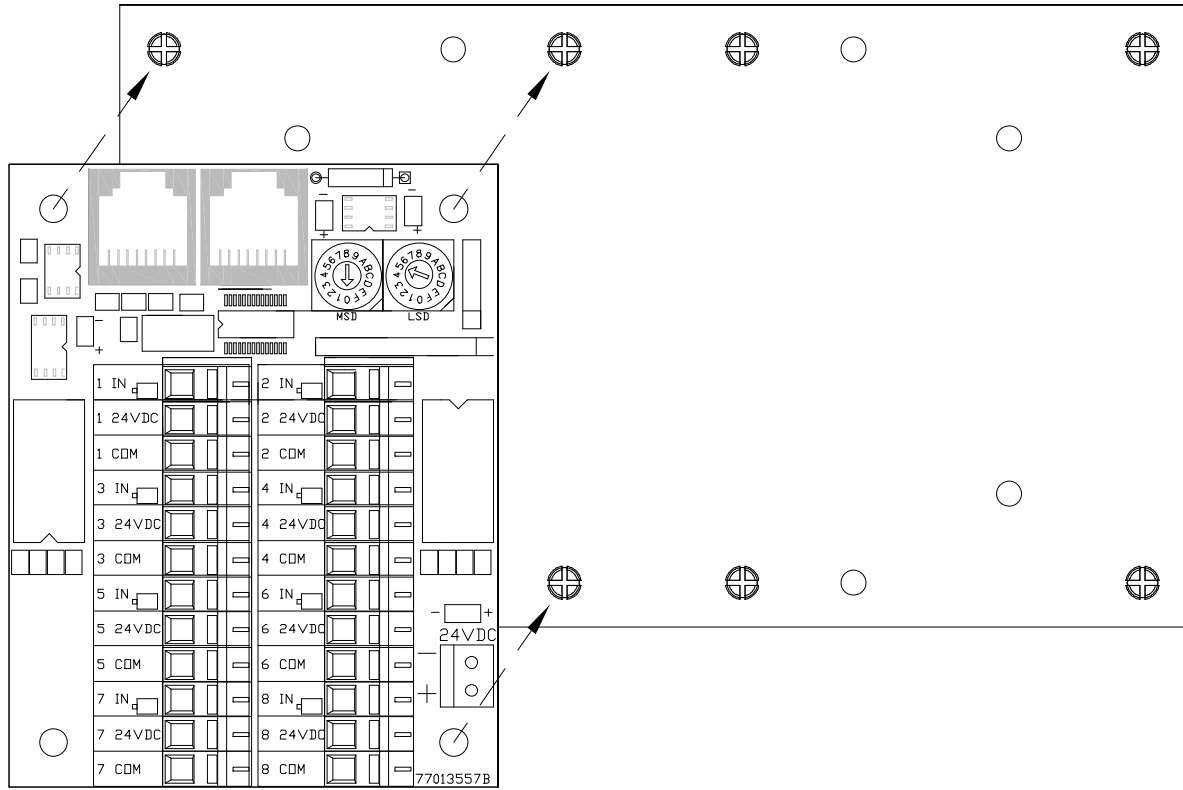

PANEL MOUNT:

The module can be mounted directly on the double plate provided with standard LightLEEDer panels. The module must go on the next available location. Turn the power to the Controller OFF. Connect in series via CAT-5 to the local port of the Controller. Set the address before powering the device.

REMOTE MOUNT:

Install provided enclosure assembly and turn the power to the Controller OFF. Connect in series to the local port of the Controller via CAT-5. Set the address before powering the device.

