


Apprentice 3

N2 Interface

Overview

The Apprentice 3 Controller can be integrated into a Building Automation System (BAS) that uses the N2 communications protocol. The host system can then poll the status of the Apprentice 3 Controller inputs and outputs and issue ON/OFF commands to the Apprentice 3's relay outputs.

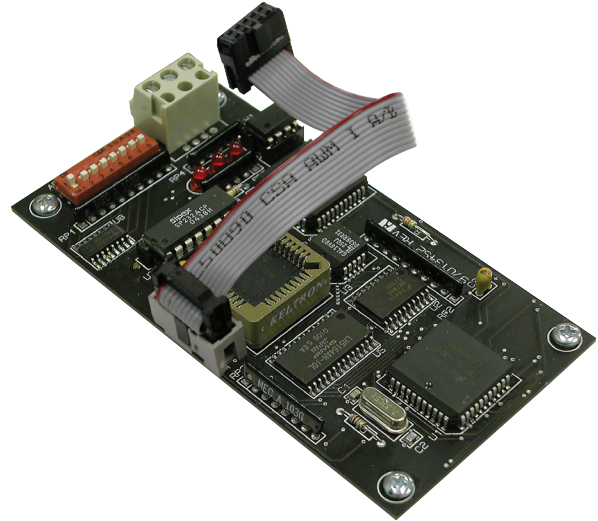

Features

- Made in the USA

Configuration

- The Apprentice 3 must be equipped with a N2 add-on module that can be addressed between 1 and 255. The network cable is a RS 485 two-wire shielded twisted pair
- Once plugged into the lighting control panel, BAS software can be programmed to control relays in the Apprentice 3 panel

- All local control features for the relay panel will continue to be operable


N2 Point Control

- BI for input status
- BO for relay status and control with Blink and Alarm Timer options
- BO for disabling and enabling input control

Warranty

Five-year limited warranty



Ordering

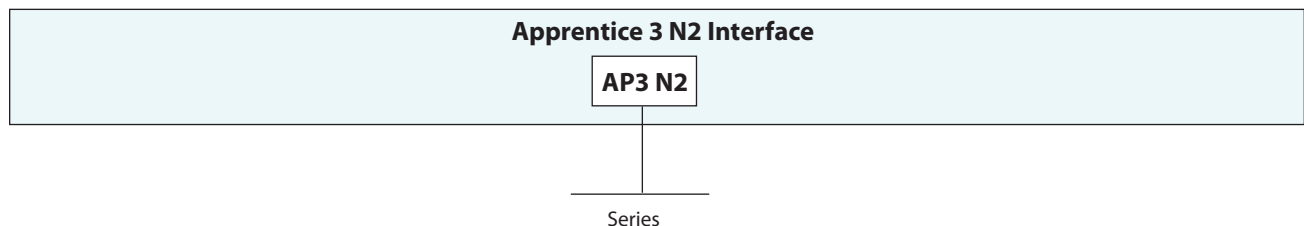

Apprentice 3

N2 Interface

Physical

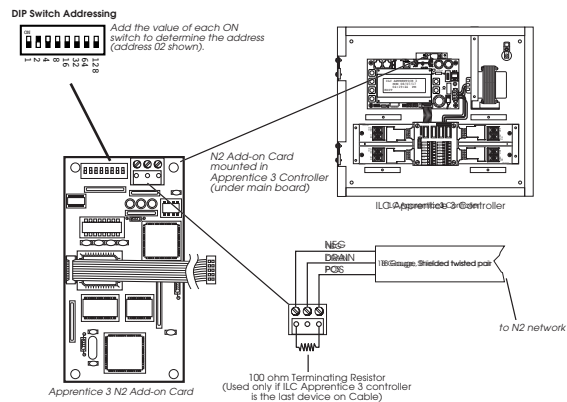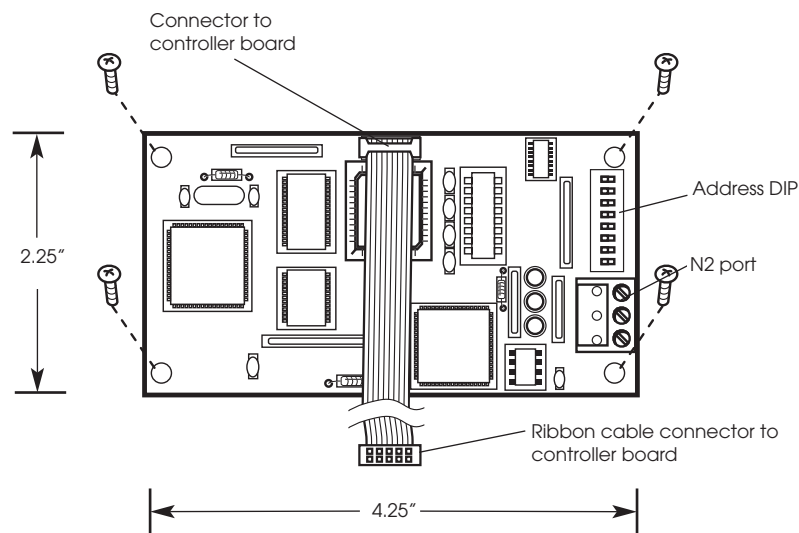

Specifications

Physical:

- Plug-in module designed for mounting in the Apprentice 3 master panel

Configuration:

- DIP switch

Operating Environment:

- Location Interior space
- Operating Temperature 0° to 50° C (32° to 112° F)
- Relative Humidity 10% to 90% Non-condensing

Certifications:

- UL CUL
- Metasys® Connectivity Partner
- FCC Approval for commercial and residential use