


# PRIVATE OFFICE CA TITLE 24 2019 DESIGN GUIDE <250sf OR IF THE LOAD IS <120W

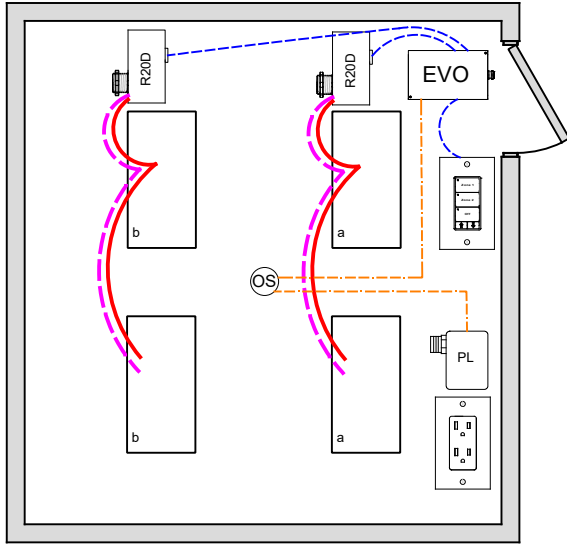

## OVERVIEW:

Lighting zones are controlled together or individually with 0-10V dimming, programmable max/min levels, vacancy off, local digital control stations.

## SEQUENCE OF OPERATION:

Lights turn on at digital switch station. Occupancy sensor input set for vacancy-off control, can be changed to on/off with adjustable dim level per zone. Plug load control is set for on/off from the occupancy sensor. Dimmer outputs provide smooth full range control, zones can be set for adjustable start level from occupancy or digital switch. Digital switch station provides individual zone on/off control and dimming, plus dimming for all zones as one.

## ADDITIONAL OPTIONS:

Multiple rooms can be controlled from a single 4-zones LLEVO panel, additional LSEVO-4X, -8X expansion panels available for up to 20 zones. Additional LightSync switch stations as needed up to 32. LL-EVO control panel can connect to ILC network for building control, and ARD Automatic Demand Response. Emergency lighting control bypass relay for UL-924 can be added as needed.

## CODE REQUIREMENTS SUPPORTED:

Auto-Off from Occupancy sensor (Section 130.1c)  
<120W Daylight control (130.1d)  
Local Switch control w/dimming (130.1a)  
Plug-Load control (130.5d)  
ADR Automatic Demand Response (130.1e)

### WIRE LEGEND

	Line voltage
	0-10V Dimming
	CAT-5e Data cable
	3-Wire Occupancy Sensor or Photo Sensor

### Bill Of Material:

Qt:	Product:	Description:
1	LLEVO	EVO Controller
2	R20D	Remote 20Amp Dimming relay
1	LSG3-WH-2-MZD	LightSync G3 2-Zone dimming digital switch station.
1	ILC-SWX-221-1	Occupancy sensor ceiling Dual Tech - 500sf
1	ILC-SWX-900-AX	Plug Load power pack

LLEVO Pre-Program: F3