


# BMS Interface Installation

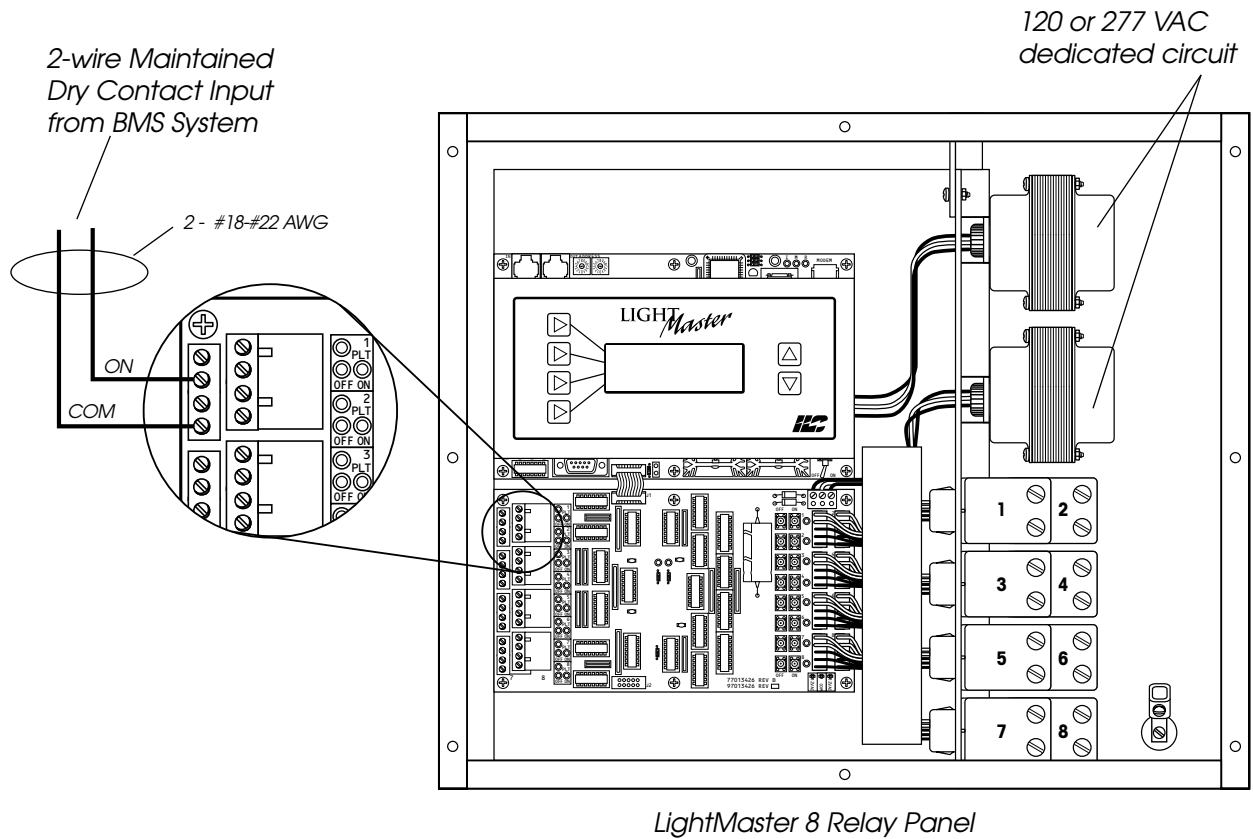

- Two conductors need to be pulled for each function - i.e. Timer Control, or ON/OFF function.
- Programming for each output mapping is done through the internal keypad.

## Typical BMS Interface Wiring