
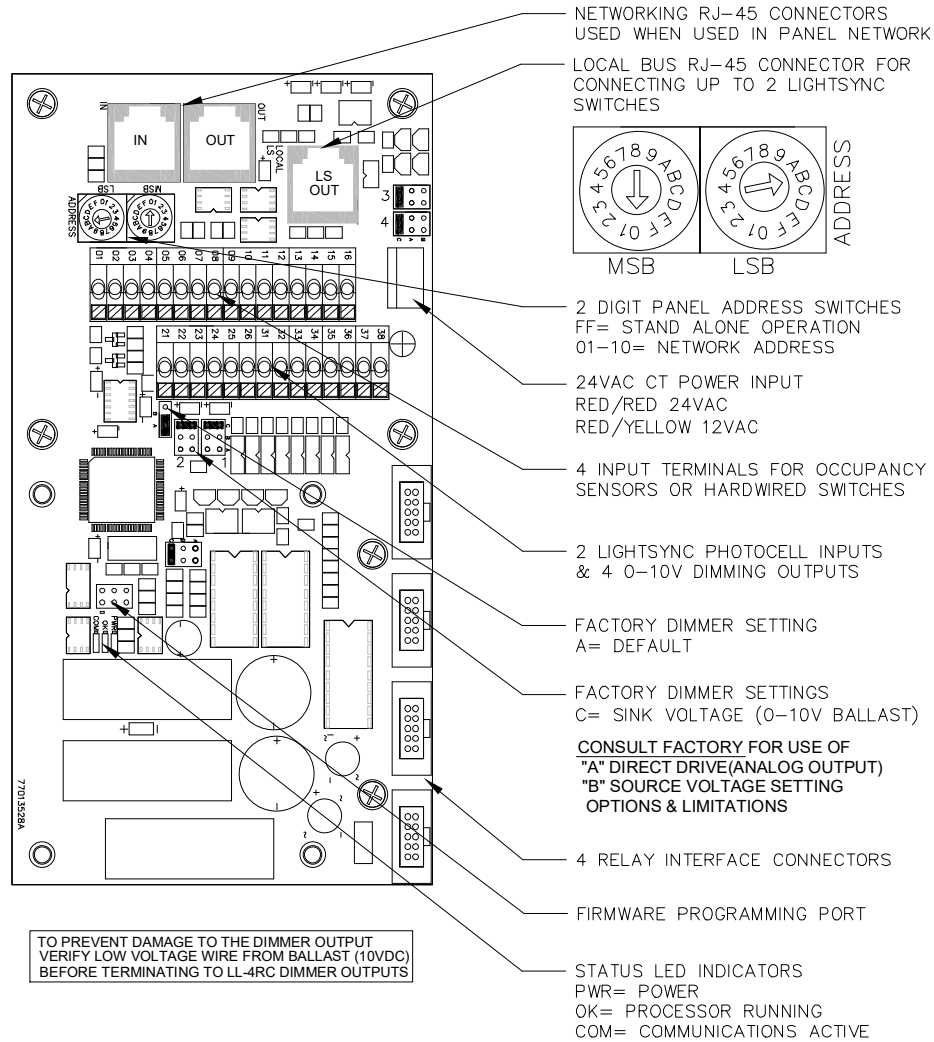
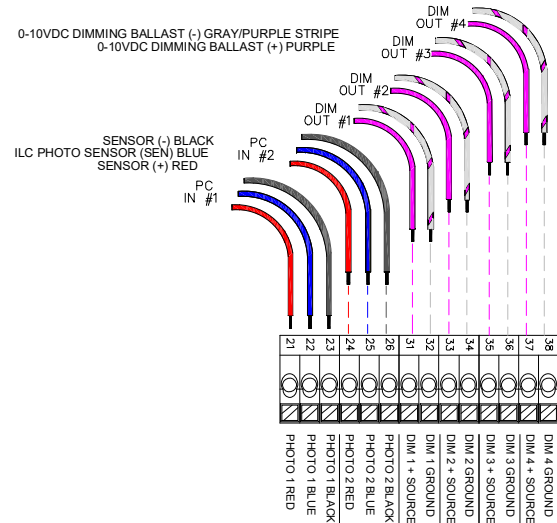
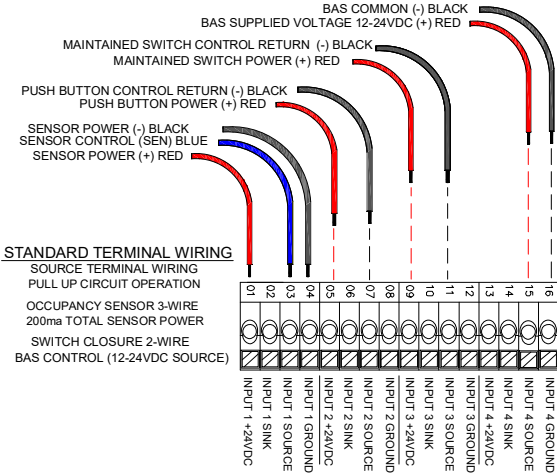


LightLEEDer 4 Load Room Controller Wiring Detail

ATTENTION INSTALLING CONTRACTOR
YOU ARE RERQUIRED TO SET THE ADDRESS
OF THIS DEVICE ACCORDING TO THE RISER
PROVIDED BY ILC. FAILURE TO DO SO WILL
MAKE THE UNIT NON-FUNCTIONAL

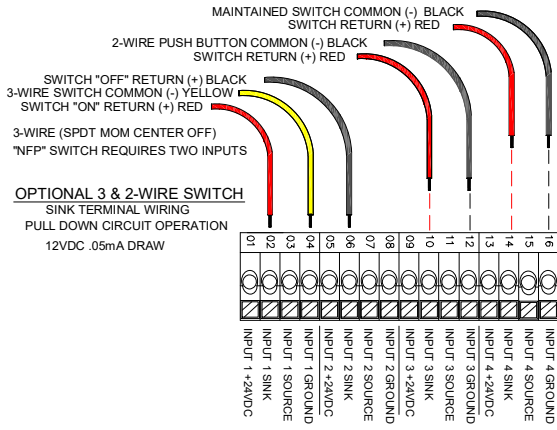

TO PREVENT DAMAGE TO THE DIMMER OUTPUT
VERIFY LOW VOLTAGE WIRE FROM BALLAST (10VDC)
BEFORE TERMINATING TO LL-4RC DIMMER OUTPUTS

TRANSFORMER TERMINATION

