


# R20D-EM External Test Switch with Power Pack Wiring Details

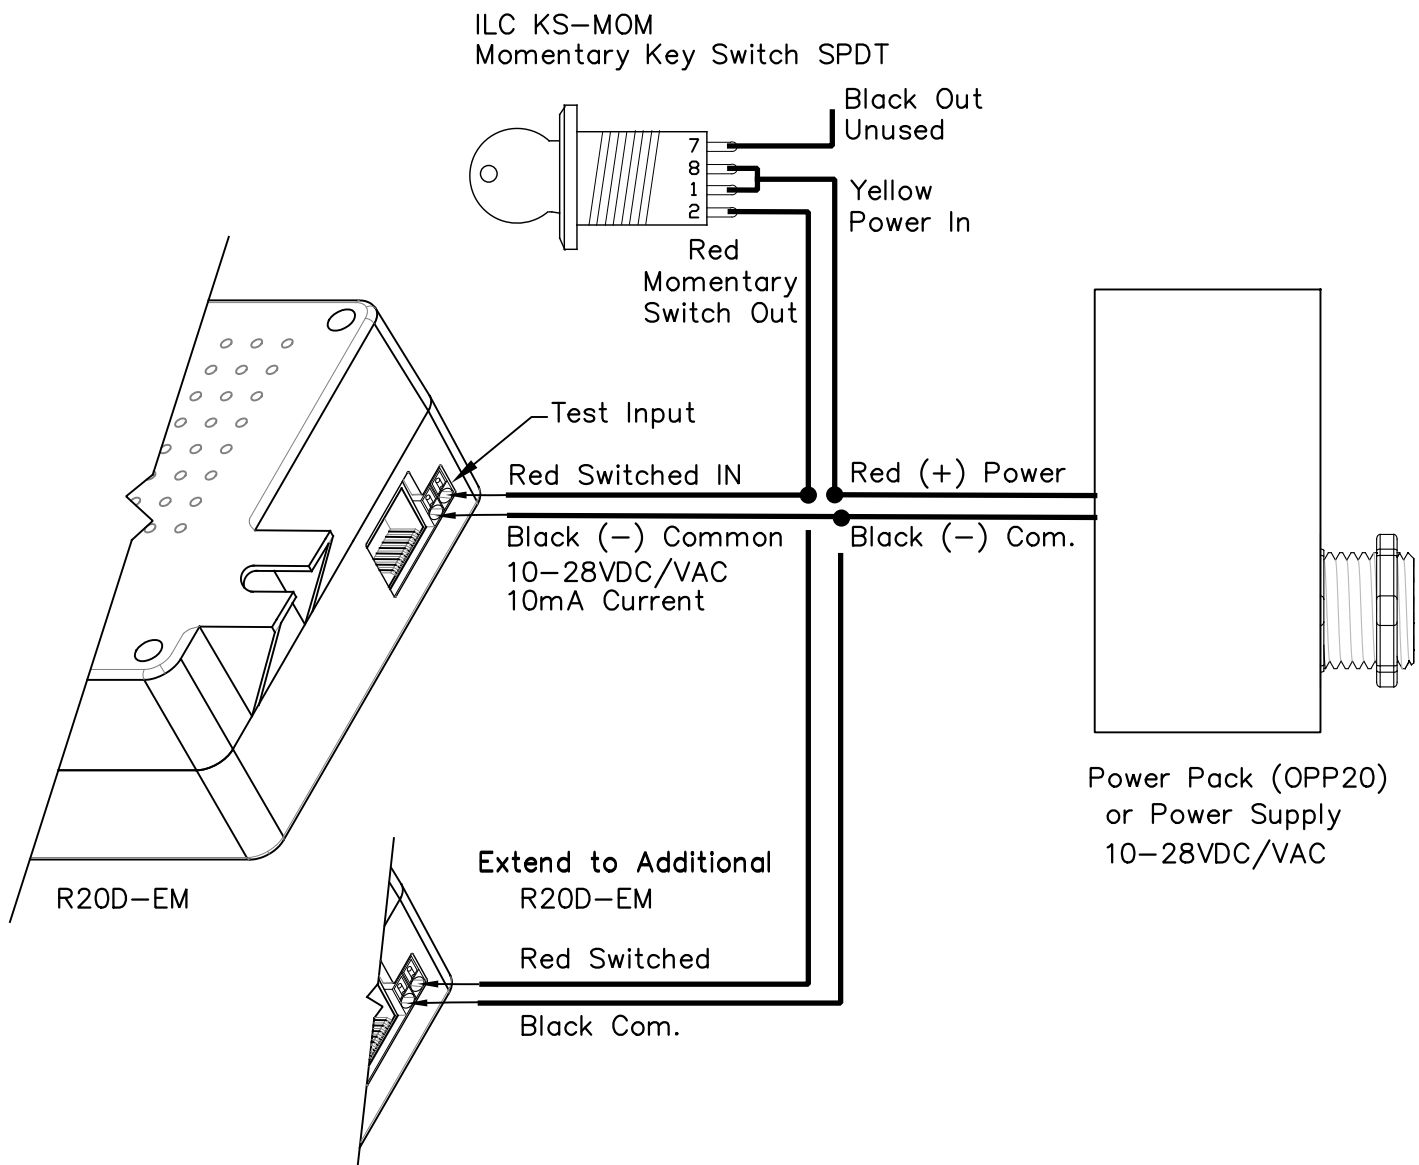

## General Information:

- Connect power supply to momentary switch and R20D-EM
- Cap all unused power pack and switch wires
- Power requirement 10-28VDC/VAC, non-polarized
- EM Test Input draws 10mA
- Extend to additional R20D-EM relays as needed
- Test the Input for connection to remote test switch or fire/security alarm system two wire powered signal